

Board of Forestry and Fire Protection

ADDITIONAL 15-DAY NOTICE OF PROPOSED RULEMAKING

“SRA Fire Safe Regulations, 2014”

**Title 14 of the California Code of Regulations (14 CCR)
Division 1.5, Chapter 7, Subchapter 2, Articles 2-5**

[Notice Published February 03, 2015]

**MODIFICATIONS TO TEXT OF PROPOSED REGULATION, SUPPLEMENTAL
STATEMENT OF REASONS AND PUBLIC HEARING DATE**

PUBLIC HEARING DATE

Pursuant to the requirements of Government Code § 11346.8(c), and Title 1 of the California Code of Regulations § 44, the State Board of Forestry and Fire Protection (Board) is providing notice of modifications, made to portions of the “SRA Fire Safe Regulations, 2014” proposed action, by the Board following the regulatory hearings conducted on August 27, 2014 and October 1, 2014. These modifications are substantially related to the 45-day Noticed rule text, published on July 4, 2014. **The Board will conduct a public hearing to consider adoption of the proposed rule text modifications at their regularly scheduled meeting on Wednesday, March 4, 2015. The meeting will begin at 8:00am in the first floor auditorium of the Resources Building located at 1416 9th Street, Sacramento, California.**

MODIFICATIONS TO TEXT OF PROPOSED REGULATION

The Board is providing notice of proposed modifications to the 45-day Notice rule text published July 4, 2014. Deletions to the rule text, associated with the first 15-Day Notice, are in double strikethrough and additions are in double underline. Deletions to the rule text, associated with the additional 15-Day Notice, are in lower-case, 8 point font, and additions are in bold. See the second to the last page of this Notice for a key to text modifications. The explanation of the proposed modifications, associated with the additional 15-Day Notice, are discussed below. However, the explanation of the proposed modifications, associated with the first 15-Day Notice, are not provided below given that they were provided in the first 15-Day Notice.

Modifications to §1273.01 Road Width

Driving surface was removed because it is not a defined term in 14 CCR § 1271.00 and traffic lanes was added because it is a defined term in 14 CCR § 1271.00. Also should be replaced with shall for clarity and to reflect the intent of the proposed action.

All roads shall be constructed to provide ~~a minimum of two nine-foot traffic lanes providing two-way traffic flow~~ a minimum *driving surface* of two ten (10) foot traffic lanes, not including shoulder and striping. These traffic lanes *should* shall provide for two-way traffic flow to support emergency vehicle and civilian egress, unless other standards are provided in this article, or additional requirements are mandated by local jurisdictions or local subdivision requirements.

Modifications to §1273.02 Roadway Surface

This modification uses the more widely utilized term “aggregate base,” and to clarify that engineering specifications may be required by the local authority having jurisdiction.

and provide an *all-weather* aggregate *road* base. Project proponent shall provide engineering specifications to support design, if requested **by the local authority having jurisdiction.**

Modifications to §1273.05 Roadway Turnarounds

This section was amended to provide clarity in the required dimensions for roadway turnarounds by inclusion of a figure.

Turnarounds are required on driveways and dead-end roads *as specified in this article.* The minimum turning radius for a turnaround shall be **forty (40) feet** *from the center line of the road, not including parking, in accordance with the following figure.* *and the encroachment of the driving surface, from the roadway into and out of the terminus bulb shall not be less than 38'. The driving surface shall be evenly tapered on both sides of the driving surface from the encroachment, 15' back along the roadway. The radius of the taper shall not exceed 40'. If a hammerhead/T is used instead, the top of the “T” shall be a minimum of sixty (60) feet in length.*

Modifications to §1273.07 Roadway Structures

Language was added to clarify requirements and approvals for signage are from the local authority having jurisdiction.

Bridges and elevated surfaces shall be designed for a live load sufficient to carry the imposed loads of fire apparatus. Vehicle load limits shall be posted at both entrances to bridges when required **by the local authority having jurisdiction.** Where elevated surfaces designed for emergency vehicle use are adjacent to surfaces which are not designed for such use, *approved barriers, approved* **or** signs, or both, **as approved by the local authority having jurisdiction,** shall be installed and maintained. A bridge with only one traffic lane may be authorized by the local jurisdiction; however, it shall provide for unobstructed visibility from one end to the other and turnouts at both ends.

Modifications to §1273.10 Driveways

The language in this section was modified to more closely match the language in 14 CCR § 1273.01, including driving surface was removed because it is not a defined term in 14 CCR § 1271.00 and traffic lane was added because it is a defined term in 14 CCR § 1271.00. Finally, the clearance requirement was moved to 14 CCR § 1276.04.

(a) All driveways shall **be constructed to** provide a minimum *driving surface* ~~of a one (1) ten (10) foot traffic lane.~~ *width of 14 feet unobstructed horizontal clearance and vertical clearance of 15 feet.* ~~10 foot traffic lane and unobstructed vertical clearance of 15 feet along its entire length.~~

Modifications to §1273.11 Gate Entrances

Changes to this section indicate that security gate approvals, and approved means of emergency gate operation, are from the local authority having jurisdiction. In addition unobstructed was added to qualify vertical clearance for the purpose of clarity.

(a) Gate entrances shall be at least two **(2)** feet wider than the width of the traffic lane(s) serving that gate and a minimum width of **fourteen (14)** feet unobstructed horizontal clearance and **unobstructed** vertical clearance of **fifteen (15)** feet.

(c) Security gates shall not be installed without approval **and w**where security gates are installed, they shall have an approved means of emergency operation. **Approval shall be by the local authority having jurisdiction.** The security gates and the emergency operation shall be maintained operational at all times.

Modifications to §1274.01 Size of Letters, Numbers and Symbols for Street and Roads Signs

Modifications to this section simplify the requirements for letters, numbers, and symbols for street and road signs from the previously noticed changes. This change goes back to the original language in the standard but changes the size and stroke of the letters, numbers, and symbols to the previously proposed 4 inches and .5 inches, respectively.

Size of letters, numbers and symbols for street and road signs shall be a minimum ~~3~~**4** inch letter height, ~~.5~~**5**³/₈ inch stroke, reflectorized, contrasting with the background color of the sign.

Numbers shall be a minimum of 4 inches (101.6 mm) high with a minimum stroke width of 0.5 inch (12.7 mm). Where access is by means of a private road and the building cannot be viewed from the public way, a monument, pole or other sign or means shall be used to identify the structure.

Modifications to §1274.09 Size of Letters, Numbers and Symbols for Addresses

Modifications to this section simplify the requirements for letters, numbers, and symbols for addresses from the previously noticed changes. This change goes back to the original language in the standard, but changes the size and stroke of the letters, numbers, and symbols to the previously proposed 4 inches and .5 inches, respectively. This section has also been modified to remove references to “building” and “structure” to provide clarity. Finally, clarifying language was provided to capture the Board’s intent and the language “Arabic numbers or alphabetical letters” was added per OAL’s suggestion.

Size of letters, numbers and symbols for addresses shall be a minimum ~~3~~⁴ inch letter height, ~~.5~~⁵-³/₈ inch stroke, reflectorized, contrasting with the background color of the sign.

New and existing buildings shall have approved address numbers, building numbers or approved building identification placed in a position that is **Address identification shall be** plainly legible and visible from the street or road fronting the property. *These numbers shall contrast with their background.* **Addresses numbers** shall be Arabic numbers or alphabetical letters. *Numbers shall be a minimum of 4 inches (101.6 mm) high with a minimum stroke width of 0.5 inch (12.7 mm).* Where access is by means of a private road and the **address identification** building cannot be viewed from the public way, a monument, pole or other sign or means shall be used to identify the **address**~~structure~~.

Modifications to §1275.01 Application

This section is amended to clarify that parcel approval and alternative methods of fire protection approval are under the authority of the local jurisdiction having authority.

The provisions of this article shall apply in the tentative and parcel map process when new parcels are approved by a **the** local jurisdiction **having authority**. When a water supply for structure defense is required to be installed, such protection shall be installed and made serviceable prior to and during the time of construction ~~except when~~ *approved* alternative methods of protection are provided **and approved by the local authority having jurisdiction.**

Modifications to §1275.10 General Standards

This section is modified to clarify that freeze protection may be required by the local jurisdiction having authority. Also, the “s” was dropped from meet or exceed for the purpose of clarity.

Water systems that comply with the below standard or standards ~~meets~~ or ~~exceeds~~ the

Where freeze protection is required by local jurisdictions **having authority**, such protection measures shall be provided.

Modifications to §1276.03 Greenbelts

This section is modified to clarify the role of CAL FIRE Unit Fire Management Plans and/or Contract County Fire Plans in the selection of community greenbelts.

The locations shall be approved by the *inspection* **local authority having jurisdiction**. *Selected locations should* **and may** be consistent with the **CAL FIRE Unit Fire Management Plan or Contract County Fire Plan**.

Modifications to §1276.04 Driveways

This section is modified to clarify the vegetation clearance and fuel reduction requirements provided in the 45-Day rule text. Additionally, a figure has been introduced and the title of the section has been changed for clarity.

1276.04 Clearance/Treatment. *Driveways*

Driveways shall have a minimum width of seven (7) feet unobstructed horizontal clearance from the centerline of the road, for a total of fourteen (14) feet, and unobstructed vertical clearance of fifteen (15) feet. In addition to the unobstructed horizontal clearance, a driveway fuel modification area of an additional eight (8) feet or to the property line, whichever comes first, along each side of the driveway shall be established in accordance with the following figure. The driveway fuel modification area is required from the point at which the driveway intersects the road to the driveway's intersection with the defensible space of the structure. Treatment in the driveway fuel modification area shall be implemented in accordance with the requirements for Zone 2 pursuant to 14 CCR § 1299.03. The driveway fuel modification area shall also apply to turnouts and turnarounds associated with driveways.

Driveways shall have minimum of ten feet horizontal fuel reduction, which includes the required clearance in 1273.10, from the traveled surface on both sides of the driveway fuel reduction zone, from the point at which the driveway meets the road to the defensible space of the structure, to support civilian evacuation and fire equipment access. The fuel reduction is such that it reflects CCR title 14, 1299 Defensible Space Zone Two. These shall include turnouts and turnarounds.

In addition several instances of the following changes without regulatory effect were made to the rule text:

- Adding the number specified in narrative in parentheses, after the narrative or where a number is provided symbolically, providing the narrative version.

PUBLIC COMMENTS

At the hearing, any person may present statements or arguments, orally or in writing relevant to the proposed modifications described in this additional 15-Day Notice. The Board requests, but does not require, that persons who make oral comments at the hearing also submit a summary of their statements.

Additionally, pursuant to Government Code § 11125.1, any information presented to the Board during the open hearing in connection with a matter subject to discussion or consideration becomes part of the public record. Such information shall be retained by the Board and shall be made available upon request.

WRITTEN COMMENT PERIOD

Any person, or authorized representative, may submit written comments relevant to the proposed regulatory action to the Board. **The written comment period ends at 5:00 P.M., February 18, 2015.** The Board will consider only written comments received at the Office of the Board of Forestry and Fire Protection by that time (in addition to those comments received at the public hearing). The Board requests, but does not require, that persons who submit written comments to the Board reference the title of the rulemaking proposal in their comments to facilitate review.

Written comments may be submitted by U.S. mail to the following address:

Board of Forestry and Fire Protection
Attn: Thambi Borrás
Regulations Coordinator
P.O. Box 944246
Sacramento, CA 94244-2460

Written comments can also be hand delivered or sent by courier to the contact person listed in this notice at the following address:

Board of Forestry and Fire Protection
Attn: Thambi Borrás
Room 1506-14
1416 9th Street
Sacramento, CA 95814

Written comments may also be sent to the Board via facsimile at the following phone number:

(916) 653-0989

Written comments may also be delivered via e-mail at the following address:

public.comments@bof.ca.gov

CONTACT PERSON

Requests for copies of the proposed text of the regulations, the *Supplemental Statement of Reasons*, modified text of the regulations and any questions regarding the substance of the proposed action may be directed to:

State Board of Forestry and Fire Protection
Attn: Thembi Borrás
P.O. Box 944246
Sacramento, CA 94244-2460
(916) 653-9633

The designated backup person in the event Ms. Borrás is not available is Mr. George Gentry, Executive Officer of the Board of Forestry and Fire Protection. Mr. Gentry may be contacted at the above address or by phone at (916) 653-8007.

AVAILABILITY OF STATEMENT OF REASONS AND TEXT OF PROPOSED REGULATIONS

The Board has prepared a Supplemental Statement of Reasons for the “SRA Fire Safe Regulations, 2014” rulemaking proposal. This document provides additional explanation of the necessity for the Board’s adoption of the proposed action. This Supplemental Statement of Reasons, Final Statement of Reasons and the Initial Statement of Reasons are available from the contact person on request. If the rule text modifications discussed in this Notice are adopted by the Board as proposed on March 4, 2015, a Supplemental Final Statement of Reasons will be prepared to reflect the comments and responses received during the written comment period and public hearing. The Supplemental Final Statement of Reasons, when prepared, will be available from the contact person(s) named in this notice.

A copy of the express terms of the original proposed action using UNDERLINE to indicate an addition to the California Code of Regulations and ~~STRIKETHROUGH~~ to indicate a deletion is also available from the contact person named in this notice.

The Board will have the entire rulemaking file, including all information considered as a basis for this proposed regulation, available for public inspection and copying throughout the rulemaking process at the following address:

California Department of Forestry and Fire Protection
Resources Building
Room 1506-14
1416 9th St.
Sacramento, CA 94244
Attention: Thembi Borrás
Tel: (916) 653-9633

All of the above referenced information is also available on the Board website at:

http://bofdata.fire.ca.gov/regulations/proposed_rule_packages/

ADDITIONAL 15-DAY NOTICE RULE TEXT MODIFICATIONS

Proposed modifications to the 45-day Noticed rule text, published on July 4, 2014 are identified in this Additional 15-Day Notice of Rulemaking rule text as follows:

Existing CCR Text ----- No underline or strikethrough

45-day Notice rule text ----- single underline

Deletions of rule text proposed in the first 15-Day Notice ----- ~~double strikethrough~~

Additions to rule text proposed in the first 15-Day Notice ----- double underline

Deletions of rule text proposed in the second 15-Day Notice ----- 8-point Arial font

Additions of rule text proposed in the second 15-Day Notice ----- **bold 12-point Arial font**

AVAILABILITY OF CHANGED OR MODIFIED TEXT

After holding the hearing and considering all timely and relevant comments received, the Board may adopt the proposed regulations substantially as described in this notice. If the Board again makes modifications which are sufficiently related to the originally proposed text, it will again make the modified text—with the changes clearly indicated—available to the public for at least 15 days before the Board adopts the regulations as revised.

Notice of the comment period and the full text as modified, will be sent to any person who:

- a) testified at the hearings,
- b) submitted comments during the public comment period, including written and oral comments received at the public hearing, or
- c) requested notification of the availability of such changes from the Board.

Requests for copies of the modified text of the regulations may be directed to the contact person listed in this notice. The Board will accept written comments on the modified regulations for no less than 15 days from the date on which they are made publicly available.

1 **SRA FIRE SAFE REGULATIONS, 2014**

2 **14 CCR, Division 1.5, Chapter 7 Fire Protection, Subchapter 2, Articles 2-5. SRA Fire Safe**
3 **Regulations**

4
5 **Article 2. Emergency Access and Egress.**

6
7 **1273.01. Road Width**

8 All roads shall be constructed to provide a ~~minimum of two nine-foot traffic lanes providing two-~~
9 ~~way traffic flow~~ a minimum driving surface of two ten (10) foot traffic lanes, not including shoulder
10 and striping. These traffic lanes should shall provide for two-way traffic flow to support
11 emergency vehicle and civilian egress, unless other standards are provided in this article, or
12 additional requirements are mandated by local jurisdictions or local subdivision requirements.

13 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
14 4290 and 4291, Public Resources Code.

15
16 **1273.02. Roadway Surface**


17 ~~The surface shall provide unobstructed access to conventional drive vehicles, including sedans~~
18 ~~and fire engines. Surfaces should be established in conformance with local ordinances, and be~~
19 ~~capable of supporting a 40,000 pound load. Roadways shall be designed and maintained to~~
20 support the imposed load of fire apparatus weighing at least 75,000 pounds and provide an all-
21 weather aggregate road base. Project proponent shall provide engineering specifications to support
22 design, if requested by the local authority having jurisdiction.

23 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
24 4290 and 4291, Public Resources Code.

1 **1273.05. Roadway Turnarounds**

2 Turnarounds are required on driveways and dead-end roads *as specified in this article*. The minimum
3 turning radius for a turnaround shall be **forty (40) feet** from the center line of the road, not including
4 parking, in accordance with the following figure. and the encroachment of the driving surface, from the
5 roadway into and out of the terminus bulb shall not be less than 38'. The driving surface shall be evenly tapered on both sides of the
6 driving surface from the encroachment, 15' back along the roadway. The radius of the taper shall not exceed 40'. If a
7 hammerhead/T is used instead, the top of the "T" shall be a minimum of **sixty (60) feet** in
8 length.

9 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
10 4290 and 4291, Public Resources Code.

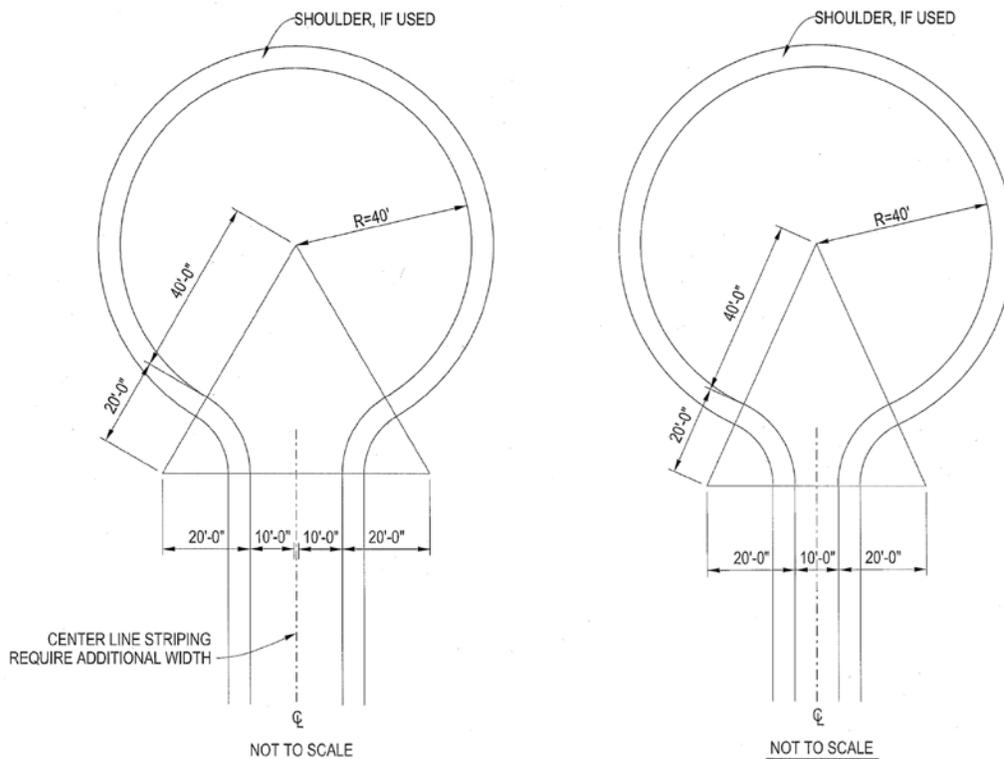

24 **FIGURE FOR 14 CCR § 1273.05. TURNAROUND EXAMPLES**

1 **1273.06. Roadway Turnouts**

2 Turnouts shall be a minimum of ~~40~~ **twelve (12)** feet wide and **thirty (30)** feet long with a
3 minimum 25 foot taper on each end.

4 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
5 4290 and 4291, Public Resources Code.

6
7 **1273.07. Roadway Structures**

8 (a) All driveway, road, street, and private lane roadway structures shall be constructed to carry
9 at least the maximum load and provide the minimum vertical clearance as required by Vehicle
10 Code Sections 35250, 35550, and 35750 ~~and 35250~~.

11 (b) Appropriate signing, including but not limited to weight or vertical clearance limitations, one-
12 way road or single lane conditions, shall reflect the capability of each bridge.

13 (c) Where a bridge or an elevated surface is part of a fire apparatus access road, the bridge
14 shall be constructed and maintained in accordance with the American Association of State and
15 Highway Transportation Officials Standard Specifications for Highway Bridges, 17th Edition,
16 published 2002 (known as AASHTO HB-17), hereby incorporated by reference. Bridges and
17 elevated surfaces shall be designed for a live load sufficient to carry the imposed loads of fire
18 apparatus. Vehicle load limits shall be posted at both entrances to bridges when required by the
19 **local authority having jurisdiction.** Where elevated surfaces designed for emergency vehicle
20 use are adjacent to surfaces which are not designed for such use, approved barriers, approved or
21 signs, or both, as approved by the local authority having jurisdiction, shall be installed and
22 maintained. A bridge with only one traffic lane may be authorized by the local jurisdiction;
23 however, it shall provide for unobstructed visibility from one end to the other and turnouts at
24 both ends.

1 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
2 4290 and 4291, Public Resources Code.

3
4 **1273.08. One-Way Roads**

5 All one-way roads shall be constructed to provide a minimum, not including shoulders, of one
6 ~~40~~12-foot traffic lane. The local jurisdiction may approve one-way roads. All one-way roads shall
7 connect to a two-lane roadway at both ends, and shall provide access to an area currently
8 zoned for no more than **ten (10)** dwelling units. In no case shall it exceed 2,640 feet in length. A
9 turnout shall be placed and constructed at approximately the midpoint of each one-way road.

10 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
11 4290 and 4291, Public Resources Code.

12
13 **1273.10. Driveways**

14 **(a)** All driveways shall **be constructed to** provide a minimum *driving surface* of a one (1) ten (10)
15 foot traffic lane. *width of 14 feet unobstructed horizontal clearance and vertical clearance of 15 feet.* ~~40-foot traffic lane~~
16 ~~and unobstructed vertical clearance of 15 feet along its entire length.~~

17 **(ab)** Driveways exceeding 150 feet in length, but less than 800 feet in length, shall provide a
18 turnout near the midpoint of the driveway. Where the driveway exceeds 800 feet, turnouts shall
19 be provided no more than 400 feet apart.

20 **(bc)** A turnaround shall be provided to all building sites on driveways over 300 feet in length, and
21 shall be within **fifty (50)** feet of the building.

22 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
23 4290 and 4291, Public Resources Code.

1 **1273.11. Gate Entrance**

2 (a) Gate entrances shall be at least two **(2)** feet wider than the width of the traffic lane(s) serving
3 that gate and a minimum width of **fourteen (14)** feet unobstructed horizontal clearance and
4 **unobstructed vertical clearance of **fifteen (15)** feet.**

5 (b) All gates providing access from a road to a driveway shall be located at least **thirty (30)** feet
6 from the roadway and shall open to allow a vehicle to stop without obstructing traffic on that
7 road.

8 (c) Security gates shall not be installed without approval and where security gates are
9 installed, they shall have an approved means of emergency operation. **Approval shall be by**
10 **the local authority having jurisdiction.** The security gates and the emergency operation shall
11 be maintained operational at all times.

12 (d) Where a one-way road with a single traffic lane provides access to a gated entrance, a **forty**
13 **(40)** foot turning radius shall be used.

14 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
15 4290 and 4291, Public Resources Code.

16
17 **1274.01. Size of Letters, Numbers and Symbols for Street and Roads Signs**

18 Size of letters, numbers, and symbols for street and road signs shall be a minimum ~~3~~**4** inch letter
19 height, ~~.5~~**5**^{3/8} inch stroke, reflectorized, contrasting with the background color of the sign.

20 *Numbers shall be a minimum of 4 inches (101.6 mm) high with a minimum stroke width of 0.5 inch (12.7 mm). Where access is by*
21 *means of a private road and the building cannot be viewed from the public way, a monument, pole or other sign or means shall be*
22 *used to identify the structure.*

23 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
24 4290 and 4291, Public Resources Code.

1 **1274.09. Size of Letters, Numbers and Symbols for Addresses**

2 Size of letters, numbers and symbols for addresses shall be a minimum ~~3~~4 inch letter height, .5
3 3/8 inch stroke, reflectorized, contrasting with the background color of the sign.

4 New and existing buildings shall have approved address numbers, building numbers or approved building identification placed in a
5 position that is **Address identification shall be plainly legible and visible from the street or road**

6 **fronting the property.** *These numbers shall contrast with their background.* **Addresses numbers shall be Arabic**
7 **numbers or alphabetical letters.** *Numbers shall be a minimum of 4 inches (101.6 mm) high with a minimum stroke width*

8 *of 0.5 inch (12.7 mm).* **Where access is by means of a private road and the address identification**
9 **building cannot be viewed from the public way, a monument, pole or other sign or means shall be**
10 **used to identify the address structure.**

11 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
12 4290 and 4291, Public Resources Code.

13
14 **1275.00. Intent**

15 Emergency water for wildfire protection shall be available, ~~and accessible,~~ and maintained in
16 quantities and locations specified in the statute and these regulations, in order to attack a
17 wildfire or defend property from a wildfire. ~~Such emergency water may be provided in a fire~~
18 ~~agency mobile water tender, or naturally occurring or man-made containment structure, as long~~
19 ~~as the specified quantity is immediately available.~~

20 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
21 4290 and 4291, Public Resources Code.

1 **1275.01. Application**

2 The provisions of this article shall apply in the tentative and parcel map process when new
3 parcels are approved by a **the** local jurisdiction **having authority**. ~~The emergency water system~~
4 ~~shall be available on-site prior to the completion of road construction, where a community water~~
5 ~~system is approved, or prior to the completion of building construction, where an individual~~
6 ~~system is approved.~~ When a water supply for structure defense is required to be installed, such
7 protection shall be installed and made serviceable prior to and during the time of construction
8 except when *approved* alternative methods of protection are provided and approved by the local
9 **authority having jurisdiction.**

10 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
11 4290 and 4291, Public Resources Code.

1 **1275.10. General Standards**

2 Water systems that comply with the below standard or standards meets or exceeds the
3 ~~standards specified in Public Utilities Commission of California (PUC) revised General Order~~
4 ~~#103, Adopted June 12, 1956 (Corrected September 7, 1983, Decision 83-09-001), Section VIII~~
5 ~~Fire Protection Standards and other applicable sections relating to fire protection water delivery~~
6 ~~systems, static water systems equaling or exceeding the National Fire Protection Association~~
7 ~~(NFPA) intent of these regulations. Water systems equaling or exceeding the National Fire~~
8 ~~Protection Association (NFPA) Standard 1231, "Standard on Water Supplies for Suburban and~~
9 ~~Rural Fire Fighting", 1989 Edition, or mobile water systems that meet the Insurance Services~~
10 ~~Office (ISO) Rural Class 8, 2nd Edition 3-80, 1142. "Standard on Water Supplies for Suburban~~
11 ~~and Rural Fire Fighting," 2012 Edition, hereby incorporated by reference, and California Fire~~
12 ~~Code 2010, California Code of Regulations Title 24, Part 9, Fire Flow requirements standard~~
13 ~~shall be accepted as meeting the requirements of this article. These documents are available at~~
14 ~~GDF Ranger Unit Headquarters. Such emergency water may be provided in a fire agency~~
15 ~~mobile water tender, or naturally occurring or man made containment structure, as long as the~~
16 ~~specified quantity is immediately available.~~ Nothing in this article prohibits the combined storage
17 of emergency wildfire and structural firefighting water supplies unless so prohibited by local
18 ordinance or specified by the local fire agency. Where freeze protection is required by local
19 jurisdictions **having authority**, such protection measures shall be provided.

20 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
21 4290 and 4291, Public Resources Code.

1 **1275.15. Hydrant/Fire Valve**

2 (a) The hydrant or fire valve shall be **eighteen (18)** inches above grade, **eight (8)** feet from
3 flammable vegetation, no closer than **four (4)** feet nor farther than **twelve (12)** feet from a
4 roadway, and in a location where fire apparatus using it will not block the roadway.

5 The hydrant serving any building shall:

6 (1) be not less than **fifty (50)** feet nor more than 1/2 mile by road from the building it is to
7 serve, and

8 (2) be located at a turnout or turnaround, along the driveway to that building or along the
9 road that intersects with that driveway.

10 (b) The hydrant head shall be ~~brass~~ with 2 1/2 inch National Hose male thread with cap for
11 pressure and gravity flow systems and 4 1/2 inch draft systems. Such hydrants shall be wet or
12 dry barrel as required by the delivery system. They shall have suitable crash protection as
13 required by the local jurisdiction.

14 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
15 4290 and 4291, Public Resources Code.

16
17 **1276.00 Intent**

18 To reduce the intensity of a wildfire by reducing the volume and density of flammable
19 vegetation, the strategic siting of fuel modification and greenbelt shall provide

20 (1) increased safety for emergency fire equipment and evacuating civilians by its utilization
21 around structures and roads, including driveways; and

22 (2) a point of attack or defense from a wildfire.

23 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
24 4290 and 4291, Public Resources Code.

1 **1276.03 Greenbelts**

2 Subdivision and other developments, which propose greenbelts as a part of the development
3 plan, shall locate said greenbelts strategically, as a separation between wildland fuels and
4 structures. The locations shall be approved by the *inspection* **local authority having jurisdiction.**

5 *Selected locations should* **and may be consistent with the CAL FIRE Unit Fire Management Plan or**
6 **Contract County Fire Plan.**

7 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
8 4290 and 4291, Public Resources Code.


9
10 **1276.04 Clearance/Treatment.** *Driveways*

11 **Driveways shall have a minimum width of seven (7) feet unobstructed horizontal**
12 **clearance from the centerline of the road, for a total of fourteen (14) feet, and**
13 **unobstructed vertical clearance of fifteen (15) feet. In addition to the unobstructed**
14 **horizontal clearance, a driveway fuel modification area of an additional eight (8) feet or to**
15 **the property line, whichever comes first, along each side of the driveway shall be**
16 **established in accordance with the following figure. The driveway fuel modification area**
17 **is required from the point at which the driveway intersects the road to the driveway's**
18 **intersection with the defensible space of the structure. Treatment in the driveway fuel**
19 **modification area shall be implemented in accordance with the requirements for Zone 2**
20 **pursuant to 14 CCR § 1299.03. The driveway fuel modification area shall also apply to**
21 **turnouts and turnarounds associated with driveways.**

22 *Driveways shall have minimum of ten feet horizontal fuel reduction, which includes the required clearance in 1273.10, from the*
23 *traveled surface on both sides of the driveway fuel reduction zone, from the point at which the driveway meets the road to the*
24 *defensible space of the structure, to support civilian evacuation and fire equipment access. The fuel reduction is such that it reflects*
25 *CCR title 14, 1299 Defensible Space Zone Two. These shall include turnouts and turnarounds.*

1 Note: Authority cited: Section 4290, Public Resources Code. Reference: Sections
2 4290 and 4291, Public Resources Code.

3
4
5 FIGURE FOR 14 CCR § 1276.04. CLEARANCE/TREATMENT EXAMPLE

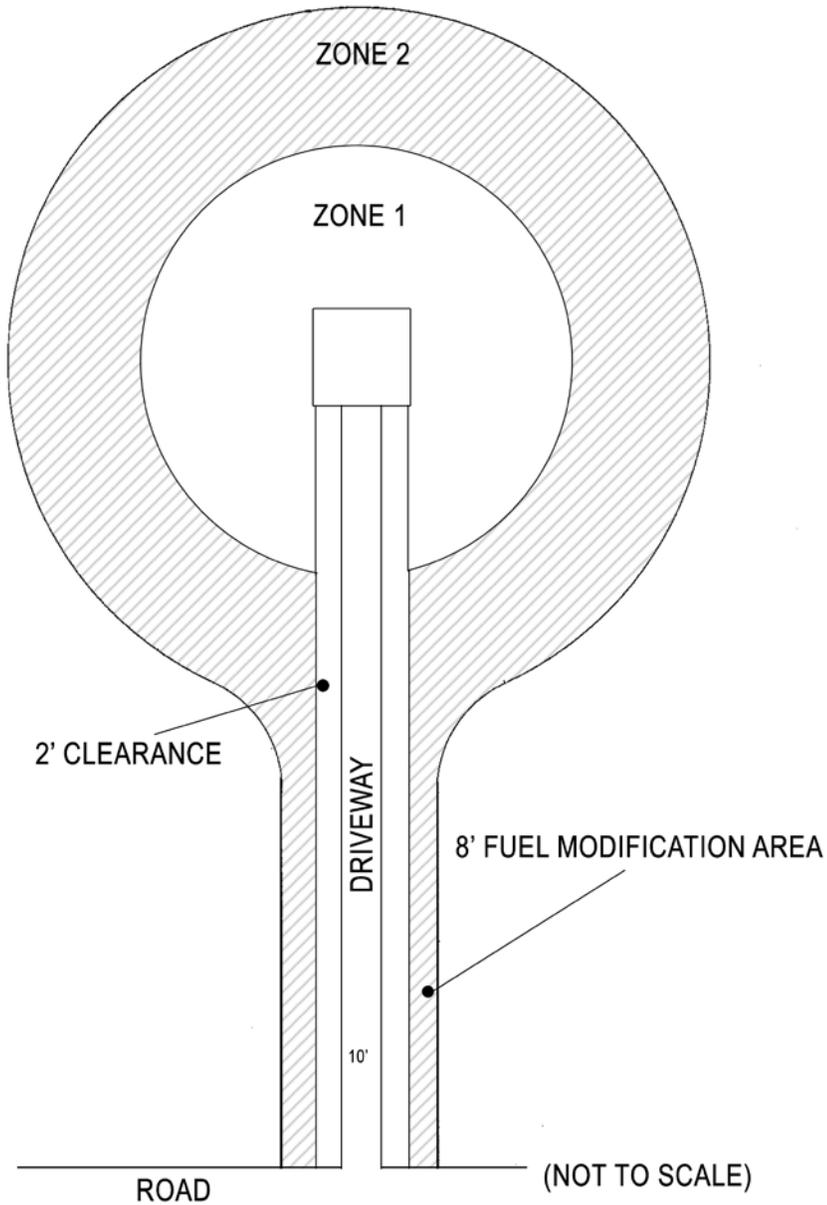

1 #####

2

3

4

5

6

7

8

9

10

11

12

13

14

15

16

17

18

19

20

21

22

23

24

25

Board of Forestry and Fire Protection

SUPPLEMENTAL STATEMENT OF REASONS

“SRA Fire Safe Regulations, 2014”

**Title 14 of the California Code of Regulations (14 CCR)
Division 1.5, Chapter 7, Subchapter 2, Articles 2-5**

The Board of Forestry and Fire Protection (Board) intends this Supplemental Statement of Reasons to provide additional information regarding the clarity and necessity (problem, purpose and rationale) of the sections (for which this information was not originally provided) in the “SRA Fire Safe Regulations, 2014” rule package currently in the regular rulemaking process.

§1273.02 Roadway Surface is amended to provide flexibility to communities designing road surfaces. It was amended to meet the needs associated with heavier fire apparatus that travel in the areas in which this regulation applies. This section requires a roadway designed and maintained to support fire apparatus weighing at least 75,000 pounds and provide an aggregate base. This requirement is in line with the California Vehicle Code, which will reduce confusion and improve compliance by the public.

§1273.07 Roadway Structures is amended to provide the requirements for bridge(s) or an elevated surface on roads used by fire apparatus. These amendments are provided in order to ensure these structures are constructed to meet the needs of the size and weight of modern fire apparatus and to ensure that the capabilities of these structures (one lane, weight limits, vertical clearance limits, etc) are clearly communicated to drivers to avoid accidents. These standards are amended to be in line with commonly known and used standards from the American Association of State Highway and Transportation Officials (AASHTO) in order to establish consistency across jurisdictions and improve compliance. AASHTO HB-17 is also incorporated into the California Fire Code, Section 503 Fire Apparatus Access Roads, and it is incorporated here to avoid confusion and improve compliance by the public.

§1273.08 One Way Roads is amended to provide clarity regarding the standards for one way roads. Field reports indicate that there was confusion in interpreting and implementing this standard as it existed previously. One way roads were being designed that provided for a 10 foot lane *including* shoulders, whereas the regulation intended to provide for a 10 foot lane *excluding* shoulders. The language of this regulation has been changed to clarify that shoulders are excluded from the width measurement of the traffic lane, and to increase the size of the traffic lane from 10 to 12 feet to meets the needs of modern fire apparatus. This will allow fire equipment and civilian vehicles to pass through one way roads safely.

§1273.10 Driveways

Pursuant to PRC § 4290(a)(1), the Board is obligated to develop road standards for fire equipment access. This section has been amended to require horizontal clearance, in addition to the vertical clearance previously required, and to provide clarity to the existing rule. Clearance is essential for fire equipment access and means both vegetation and other obstructions.

§1273.11 Gate Entrance is amended to provide width, clearance, distance, and emergency operation standards for gated entrances. Horizontal and vertical clearance requirements were added to the standard so that as a vehicle passes through a public roadway, a gated area, and then a private driveway, there is consistent vegetation clearance that would allow for safe passage of fire equipment apparatus. Minimum requirements for security gates were added to ensure that the security gates had a means of emergency operation approved by the local authority having jurisdiction; however, the requirement allows local jurisdictions to set individual requirements for approved means of emergency operations.

§1274.01 Size of Letters, Numbers and Symbols for Street and Roads Signs is amended to conform with the requirements in the California Fire Code, Section 505 Premise Identification. The size of letters, numbers, and symbols has been changed from a minimum 3 inch height and 3/8 inch stroke to a minimum 4 inch height and .5 inch stroke. By aligning these two standards, this regulation ensures that the letters, numbers, and symbols on street and road signs are visible and legible to emergency responders and others.

§1274.09 Size of Letters, Numbers and Symbols for Addresses is amended to conform with the requirements in the California Fire Code, Section 505 Premise Identification. The size of letters, numbers, and symbols has been changed from a minimum 3 inch height and 3/8 inch stroke to a minimum 4 inch height and .5 inch stroke. This rule also requires the address be posted on a monument, pole, or other sign if it cannot be viewed from a public way. Aligning these two standards will reduce confusion during implementation and ensure that letters, numbers, and symbols on addresses are visible and legible to emergency responders and others.

§1275.00 Intent is amended to move the second sentence of the existing regulation to a more appropriate section. It was also amended to require the maintenance of water in specified quantities and locations, in addition to the water's availability and accessibility, in order to clarify the original intent of the regulation. This addition is necessitated by misinterpretations while implementing this standard. The regulation was intended to provide for emergency water available and ready to use during the life of a project, and not just the construction and inspection phases, and adding "and maintained" to this regulation clarifies that intention.

§1275.01 Application is amended to clarify when the standards for emergency water supply must be met during the development process. The original standard was confusing and resulted in mixed levels of compliance by the public. The new standard specifies that this standard applies when new parcels are approved in the tentative and parcel map process by the local jurisdiction having authority, and that water supply must be available and made serviceable prior to and during construction except when alternatives are approved by the local jurisdiction. The existing standard was unclear regarding those issues and this new regulation text clarifies that information.

§1275.10 General Standards is amended to clarify the water supply requirements, provide flexibility to local jurisdictions, and is the new location of the sentence struck from 14 CCR §1275.00 “Intent” regarding how emergency water may be provided. This section incorporates the National Fire Protection 1142 “Standard on Water Supplies for Suburban and Rural Fire Fighting,” 2012 edition, and the California Fire Code Section 507 Fire Protection Water Supplies because they are known and common standards available for review online, for free, that will improve compliance and assist the public in understanding the requirements of the regulation. This section was amended to modernize the water supply requirements and provide flexible alternatives to project proponents.

§1276.00 Intent is amended to better address the need for regulations that implement the Public Resources Code 4290 requirement that the Board adopt regulations creating “road standards for fire equipment access.” Pursuant to PRC § 4290(a)(1), the Board is obligated to develop road standards for fire equipment access. This section has been amended to specifically include structures and roads (including driveways) because reducing the volume and density of flammable vegetation around structures and roads (including driveways) enables fire equipment safe passage from public roadways to driveways to structure, which ultimately facilitates structure defense and protection of life. Clearance is used to mean both vegetation and other obstructions. The amendments to this Intent section are an attempt to make that clearer.

§1276.03 Greenbelts is amended to ensure that land use decisions, such as greenbelts, are consistent with additional fire protection and land use plans in a community. The cited documents, CAL FIRE Unit Management Plans and Contract County Fire Plans, are plans updated regularly to consider aspects of fire protection planning such as the siting of greenbelts in a community. The change to this regulation is to ensure that those pre-plans are referenced during subdivision planning and development.

§1276.04 Clearance/Treatment. is adopted to ensure the safety of those traveling between the public roadway and any structures. Horizontal fuel reduction standards exist for roadways, roadway structures, and buildings, and requiring similar fuel reduction to a degree equivalent to that around buildings continues to support the goal of safe ingress and egress in areas of high fire risk. This standard creates a safe route for modern fire apparatus to travel from the public roadway through a private driveway to reach a home that they may be able to defend during a wildfire. The rule also allows civilian vehicles to evacuate safely simultaneously.

INCORPORATION BY REFERENCE (pursuant to 1 CCR § 20(c)(1))

The two documents that are incorporated by reference (see below) in these regulations (specifically referenced in 14 CCR §§ 1273.07 and 1275.10) were selected, among all the other standards out there, because of their common use and common recognition of them.

American Association of State and Highway Transportation Officials Standard Specifications for Highway Bridges, 17th Edition, published 2002 (known as AASHTO HB-17)

National Fire Protection Association (NFPA) Standard 1142, "Standard on Water Supplies for Suburban and Rural Fire Fighting," 2012 Edition